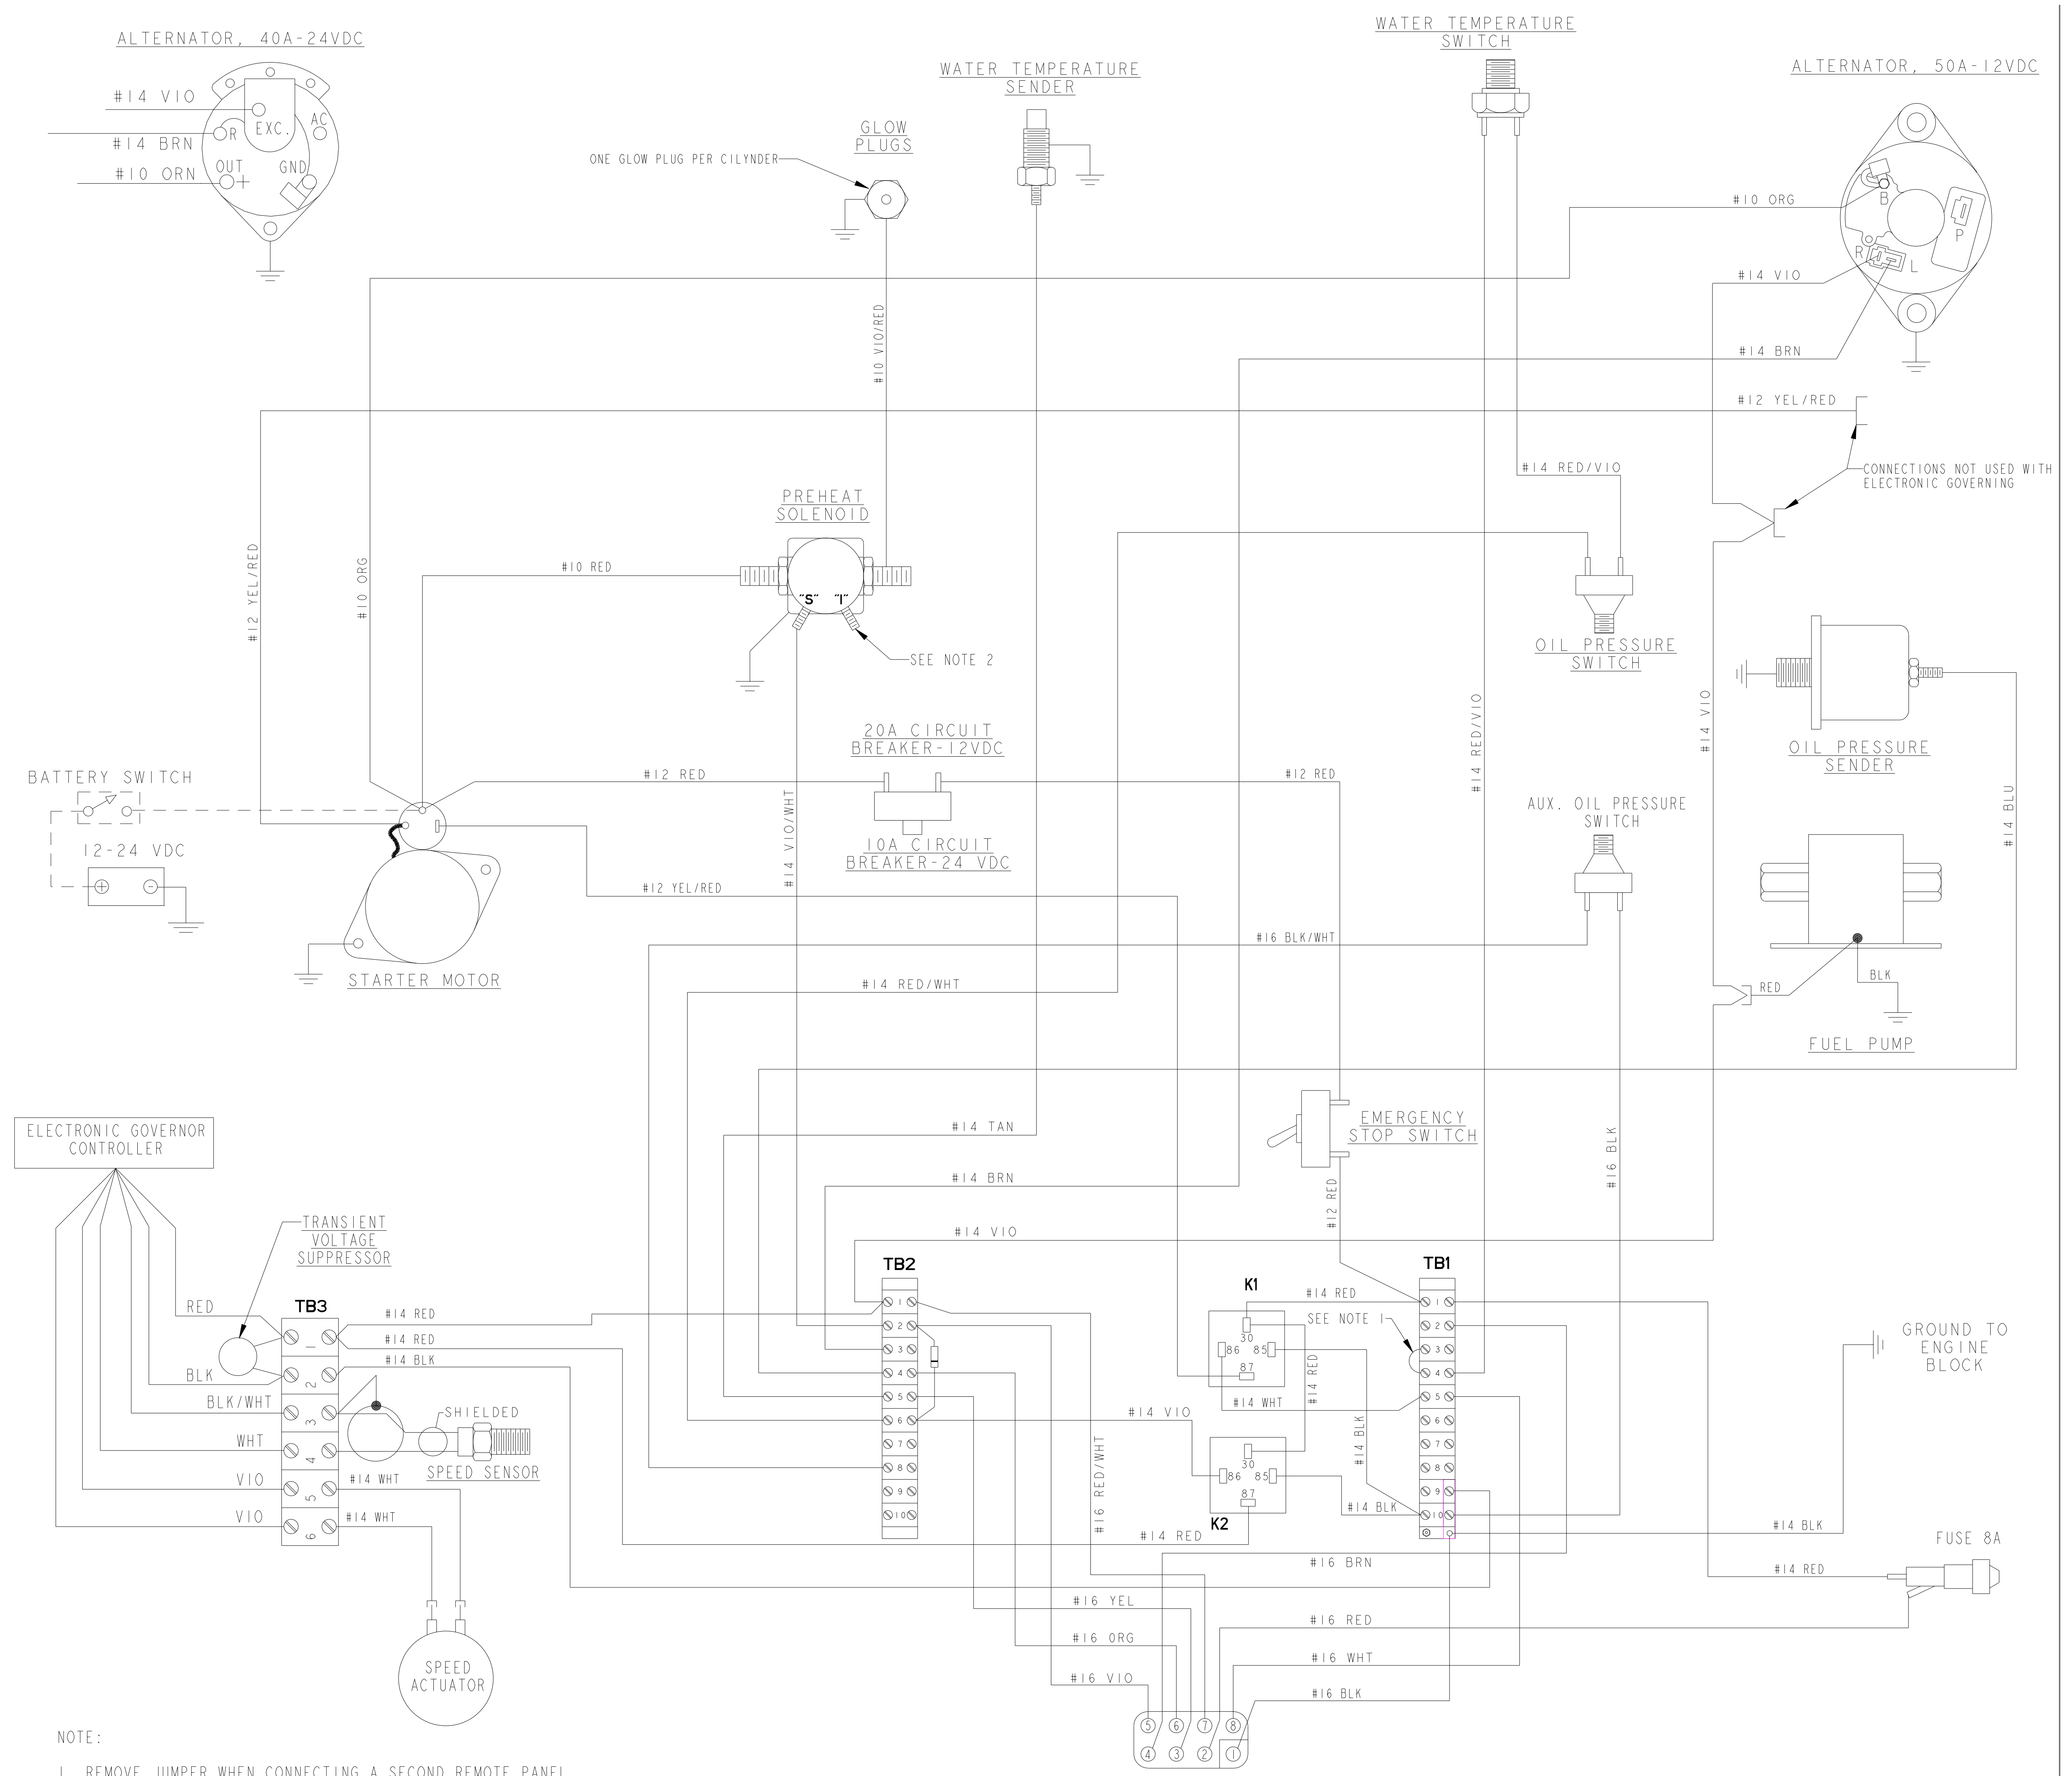

NOTE:

1. REMOVE JUMPER WHEN CONNECTING A SECOND REMOTE PANEL.
2. GROUND "I" TERMINAL OF PREHEAT SOLENOID ON 24V SYSTEM ONLY.

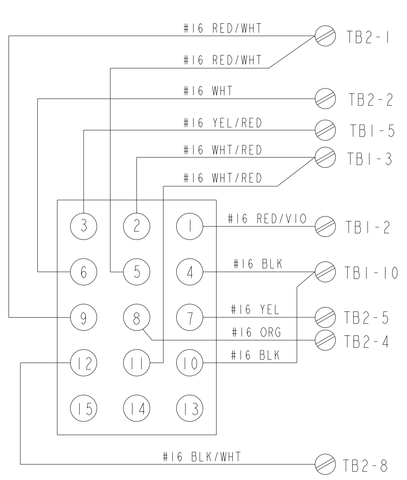

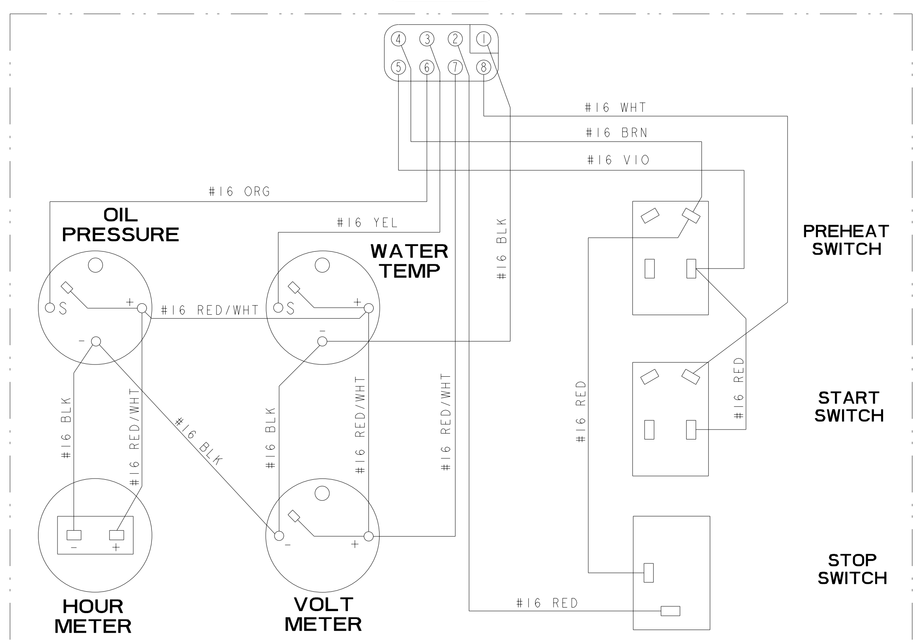

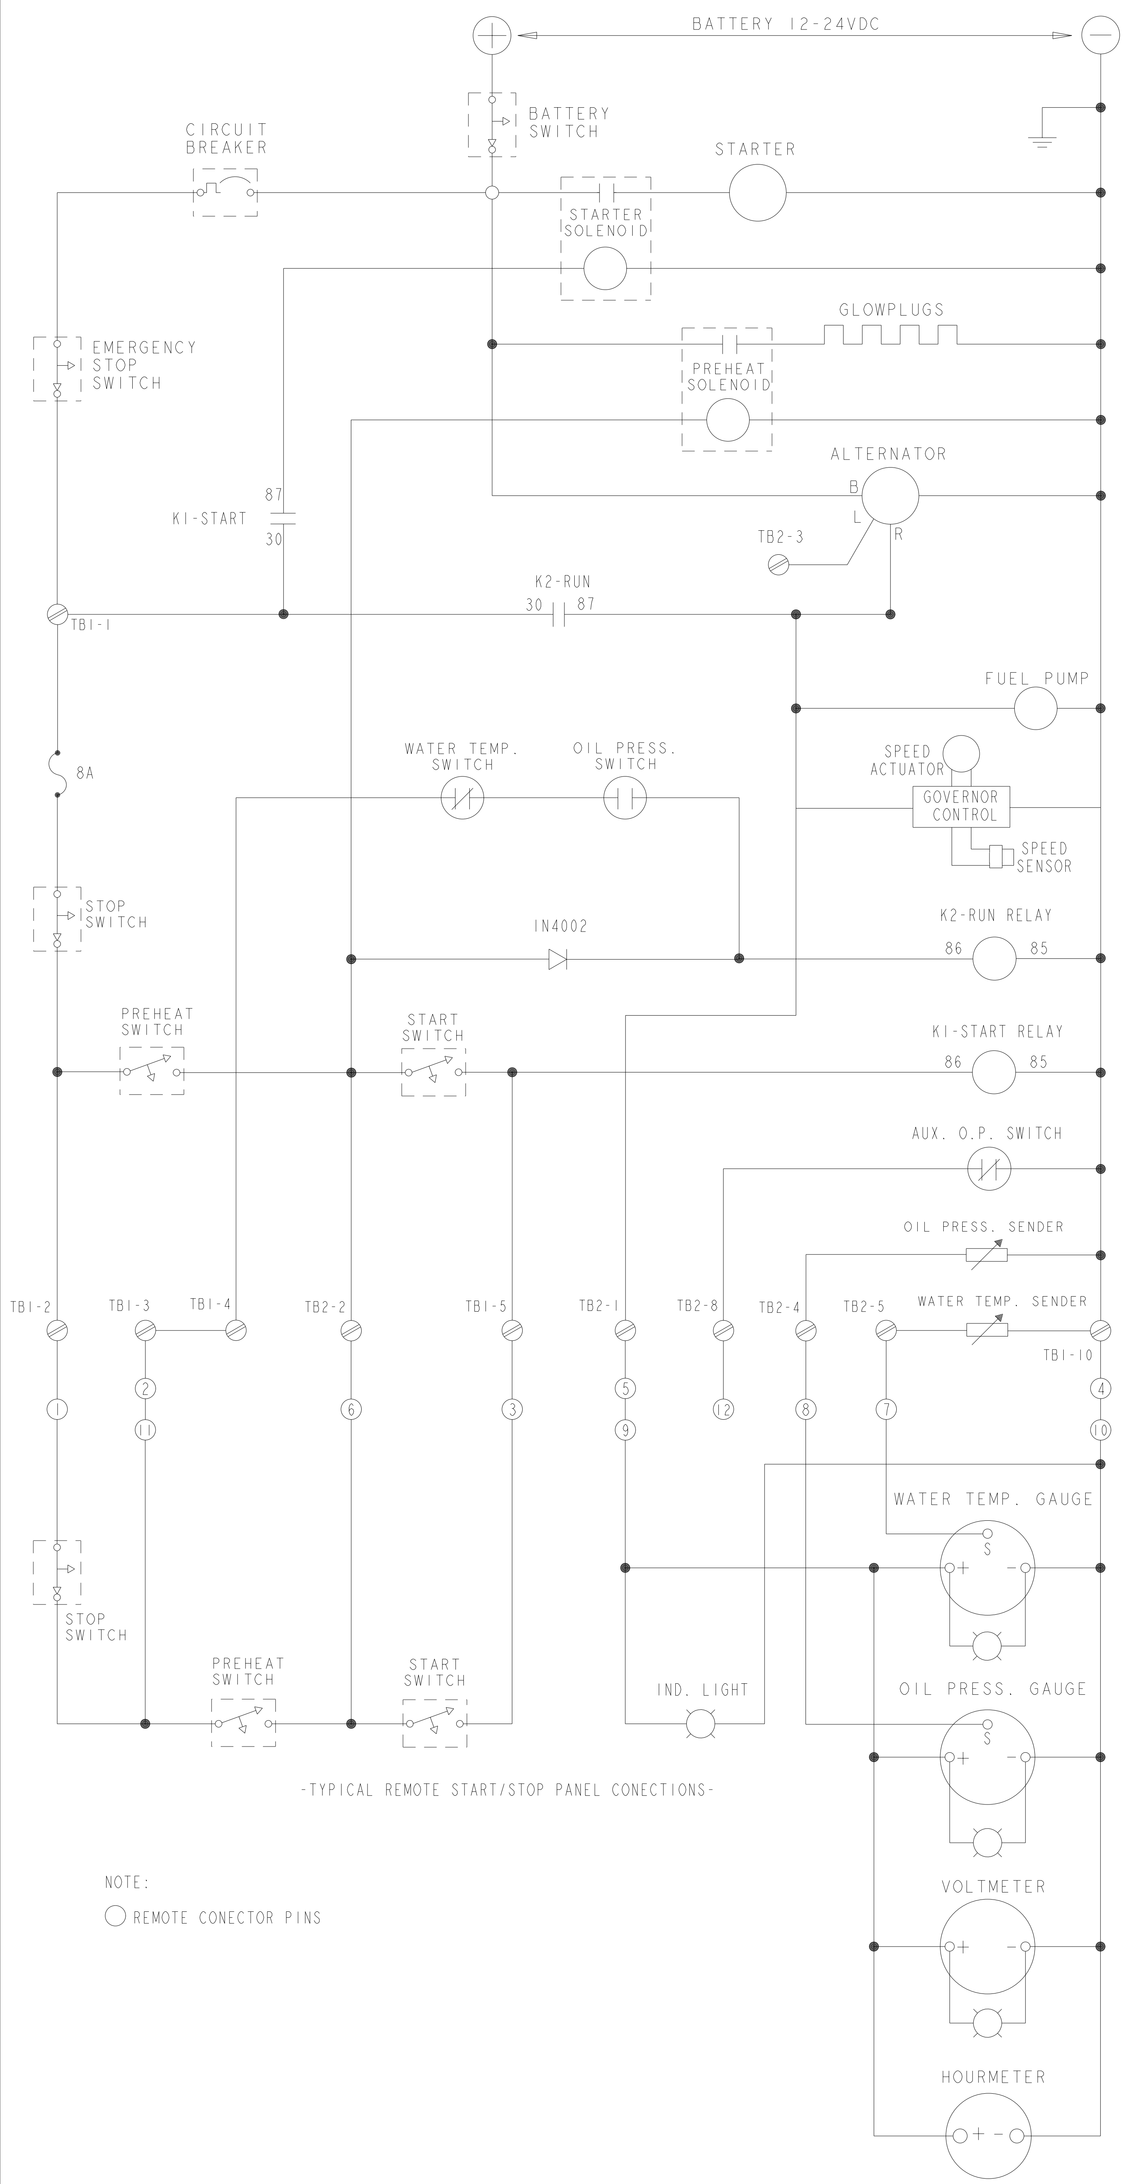

-TYPICAL REMOTE START/STOP PANEL CONECTIONS-

NOTE:

○ REMOTE CONECTOR PINS

ECO NO.	DATE	REV.	REVISION RECORD	AUTH.	DR.BY

ECO NO.	DATE	REV.	REVISION RECORD	AUTH.	DR.BY

TOLERANCES (UNLESS OTHERWISE NOTED)
INCHES: .XX ± .02, .XXX ± .005, CAST ± .03, ANGLES ± 5°, FINISH
MILLIMETERS: X ± , .XX ±
DIMENSIONS: INCHES / MILLIMETERS (WHEN APPLICABLE)

WESTERBEKE CORPORATION
AVON MA. 02322

TITLE: WIRING DIAGRAM/SCHEMATIC, 8.0 BTDAR, 10.0 BTDAR, 12.5 BTDBR, 15.0 BTDCR - SRC W/ELECT GOV.

DRAWN BY	DATE	MATERIAL
JRS	19/JUNE/00	-
APPROVED BY	DATE	-
SCALE NONE	SIZE	DRAWING NUMBER
SHT. 1 OF 1	E	44969

REV. -