


ECO NO.	DATE	REV.	REVISION RECORD	AUTH.	DR. BY
6235	8-25-2006	A	RELEASED TO SYSTEM.		
6289	12-19-2006	B	ADDED 1 AMP FUSE, FIRE SUPPRESSION SYSTEM AND TERMINAL STRIPS TO THE WIRING DIAGRAM. ADDED OPTIONAL REMOTE S/S CONNECTION.		GA
6297	1-5-2006	C	P2-PIN 24 WAS CONNECTED TO K1-PIN 86.		GA
6309	2-1-2007	D	REROUTE K1-30 (16-RED) TO K1-86. REMOVE JUMPER WIRE (16-RED) BETWEEN K2-30 AND K3-30. REROUTE K3-86 (16-WHT/RED) TO K3-30. ADD JUMPER WIRE (16-RED) BETWEEN K3-30 AND K3-86. REROUTE K3-30 (12-RED) TO K2-30.		GA
6350	6-29-2007	E	ADDED T-ADAPTER CONNECTION. ADDED OPTIONAL POWER SOURCE.		GA
6443	1-17-2008	F	SHOW WESTERLINK TERMINAL BLOCK WIRING CONFIGURATION.		GA
6629	8-25-2009	G	UPDATE VOLTAGE SENSE BOARD AND CLARIFY CIRCUIT BRK CONNECTION.		GA

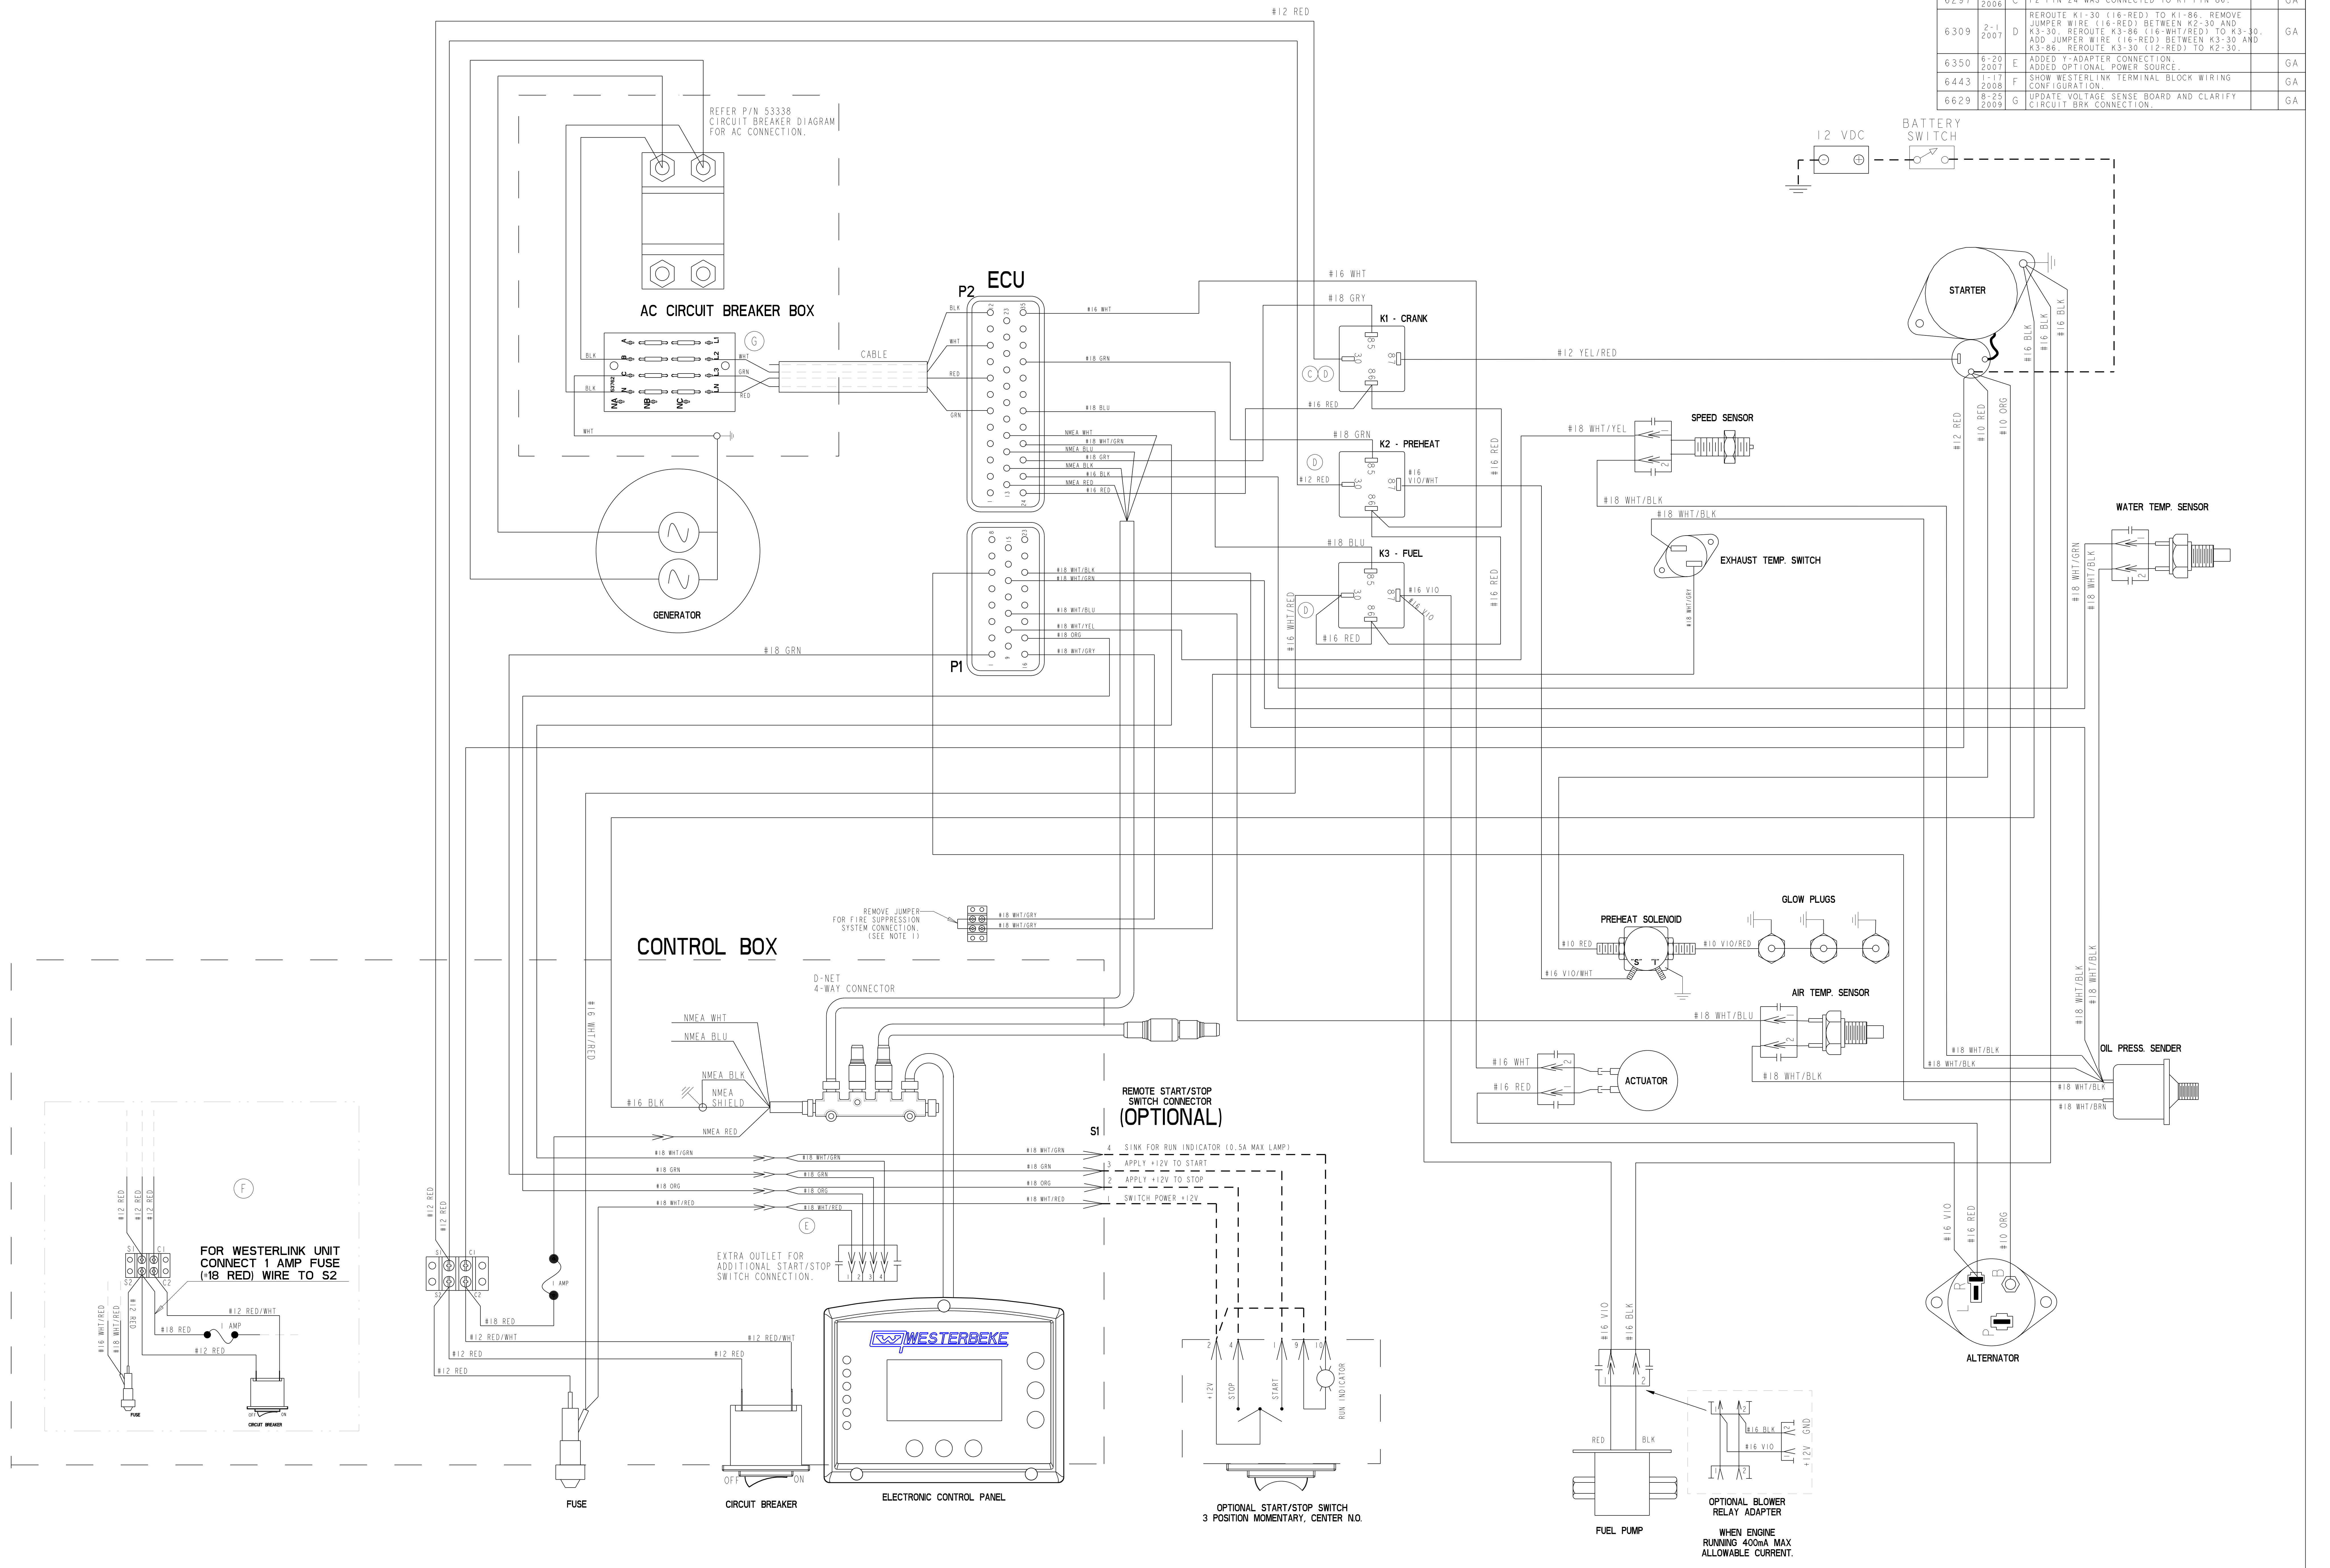

NOTE:  
1. FIRE SUPPRESSION SYSTEM CONNECTION IS NOT A POWER SOURCE. THIS CIRCUIT MUST BE CLOSED TO RUN. OPEN TO STOP GENSET.

TOLERANCES (UNLESS OTHERWISE NOTED)		WESTERBEKE CORPORATION TAUNTON, MA 02780	
INCHES	MILLIMETERS	FILE	
XX ± .02	X ± 1.0	DGGENSET WIRE 5.5 EDC, 7.6-15.0 EDT	
XXX ± .005	XX ± .13	D-NET (WESTERLINK & NMEA 2000)	
FINISH	SIZE	DRAWN BY	DATE
		GA	2/7/2006
DIMENSIONS	APPROVED BY	DATE	MATERIAL
INCHES	SCALE NONE		
MILLIMETERS	SIZE	DRAWING NUMBER	REV.
(WHEN APPLICABLE)	Sht. 1 of 1	E	52793