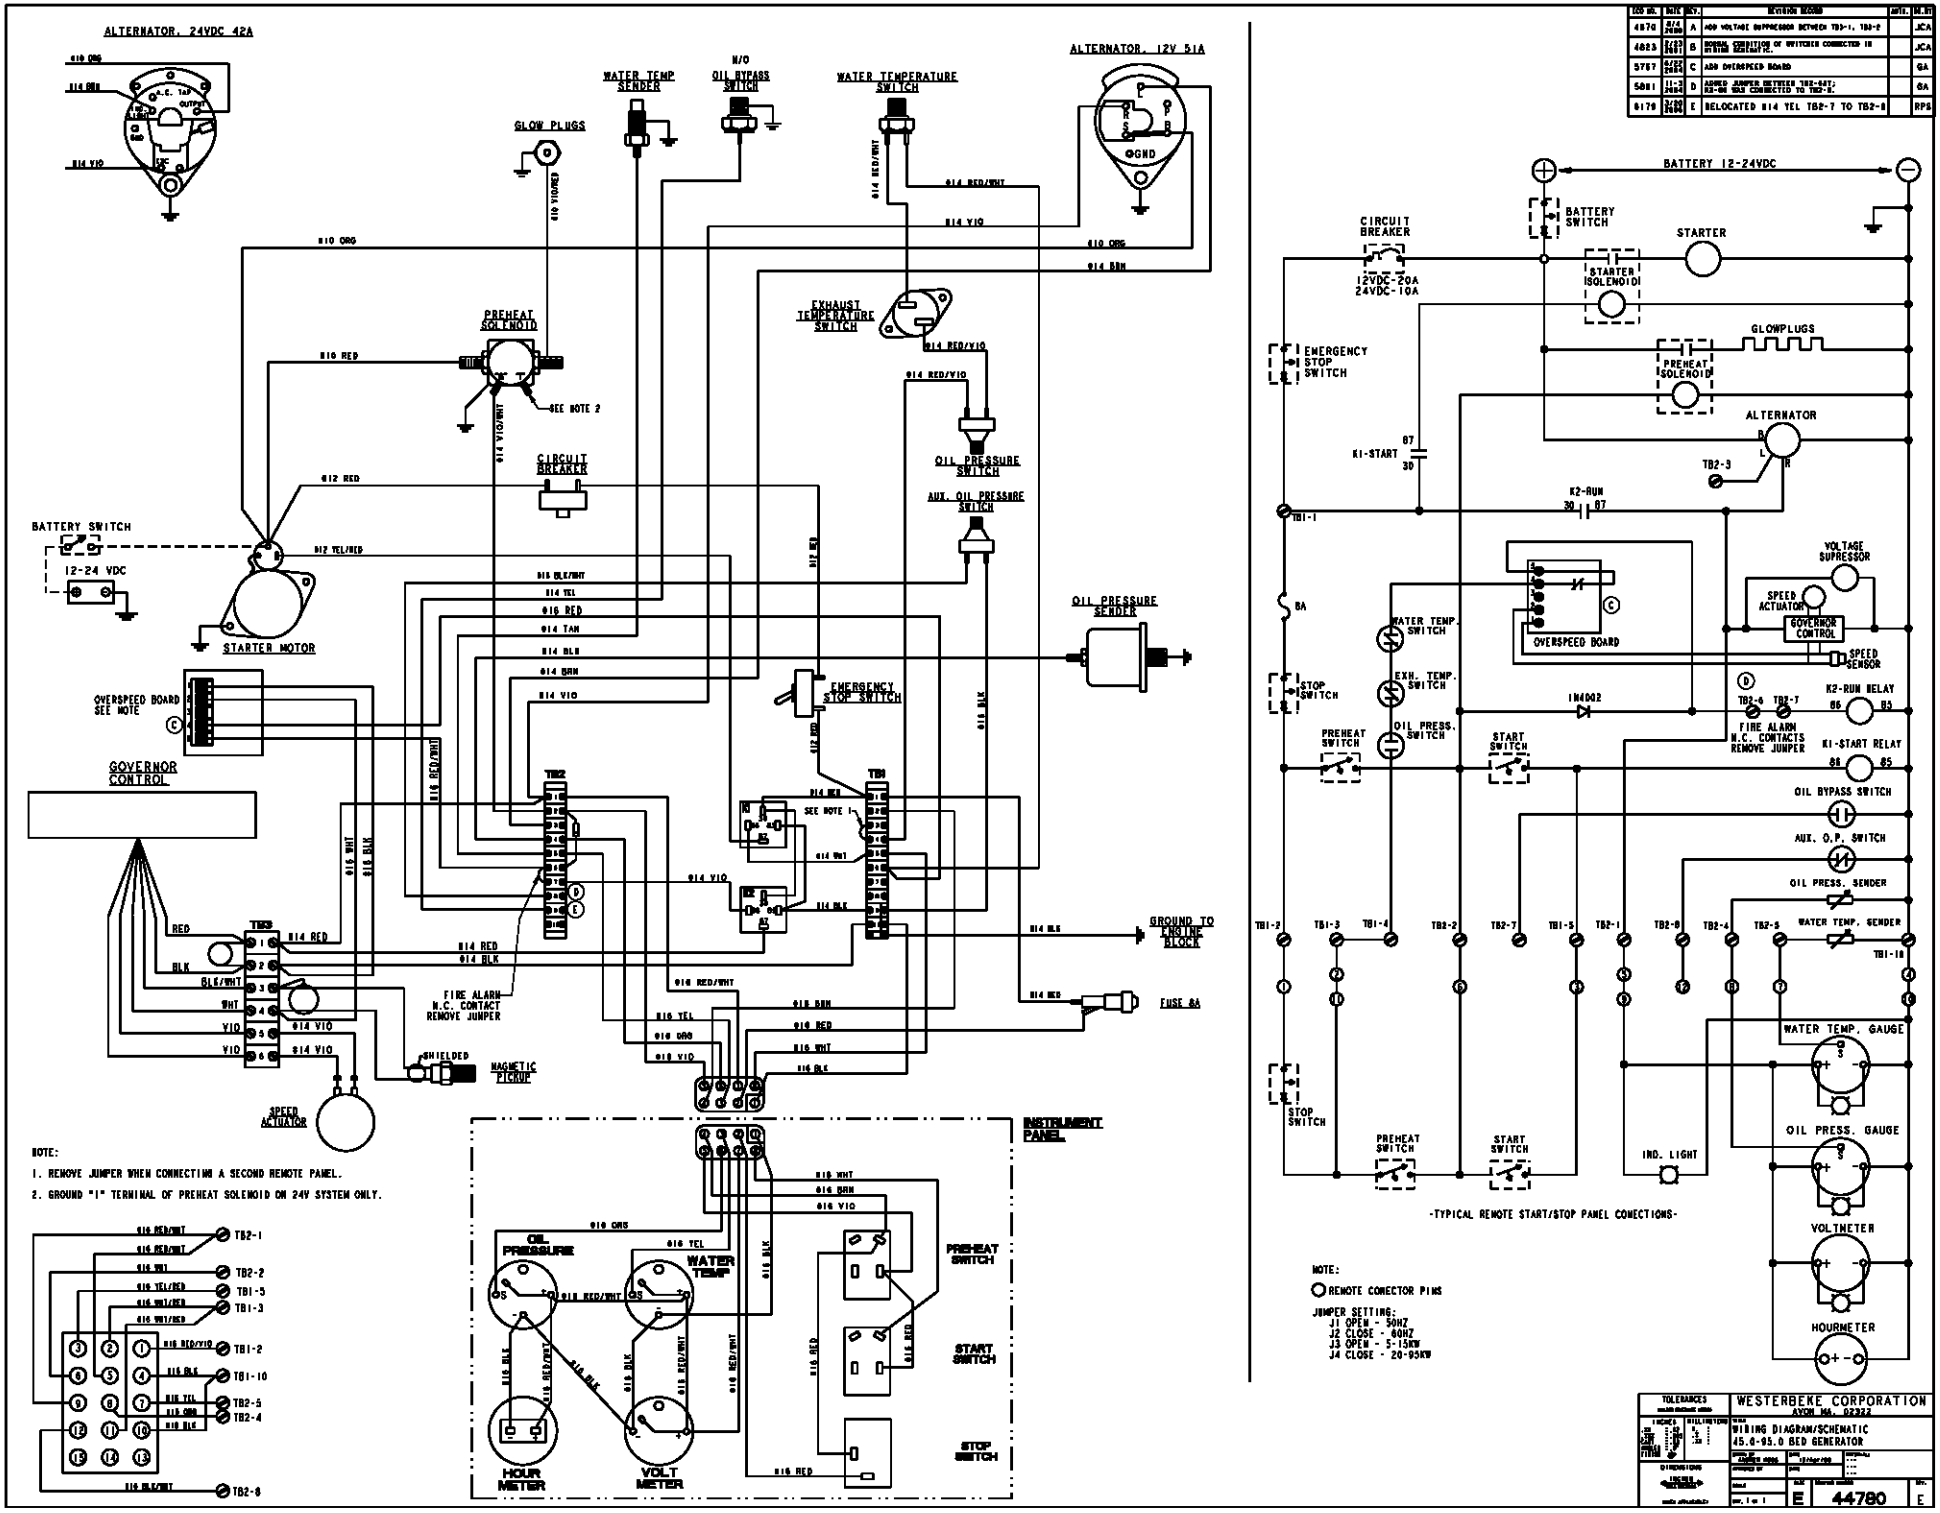

NOTE:

1. REMOVE JUMPER WHEN CONNECTING A SECOND REMOTE PANEL.
2. GROUND "1" TERMINAL OF PREHEAT SOLENOID ON 24V SYSTEM ONLY.

ECO NO.	DATE	REV.	REVISION RECORD	APPR.	DR. BY
4870	8/4 2000	A	ADD VOLTAGE SUPPRESSOR BETWEEN TB3-1, TB3-2		JCA
4823	2/23 2001	B	NORMAL CONDITION OF SWITCHES CONNECTED IN WIRING SCHEMATIC.		JCA
5767	4/22 2004	C	ADD OVERSPEED BOARD		GA
5881	11-3 2004	D	ADDED JUMPER BETWEEN TB2-6&7; R2-86 WAS CONNECTED TO TB2-8.		GA
6179	3/30 2006	E	RELOCATED #14 YEL TB2-7 TO TB2-8		RPS