


ECO NO.	DATE	REV.	REVISION RECORD	AUTH.	DR. BY
6282	11-79	A	RELEASED TO SYSTEM.		GA
6289	12-28-2004	B	ADDED 1 AMP FUSE, FIRE SUPPRESSION SYSTEM AND TERMINAL STRIPS TO THE WIRING DIAGRAM. ADDED OPTIOINAL REMOTE S/S CONNECTION		GA

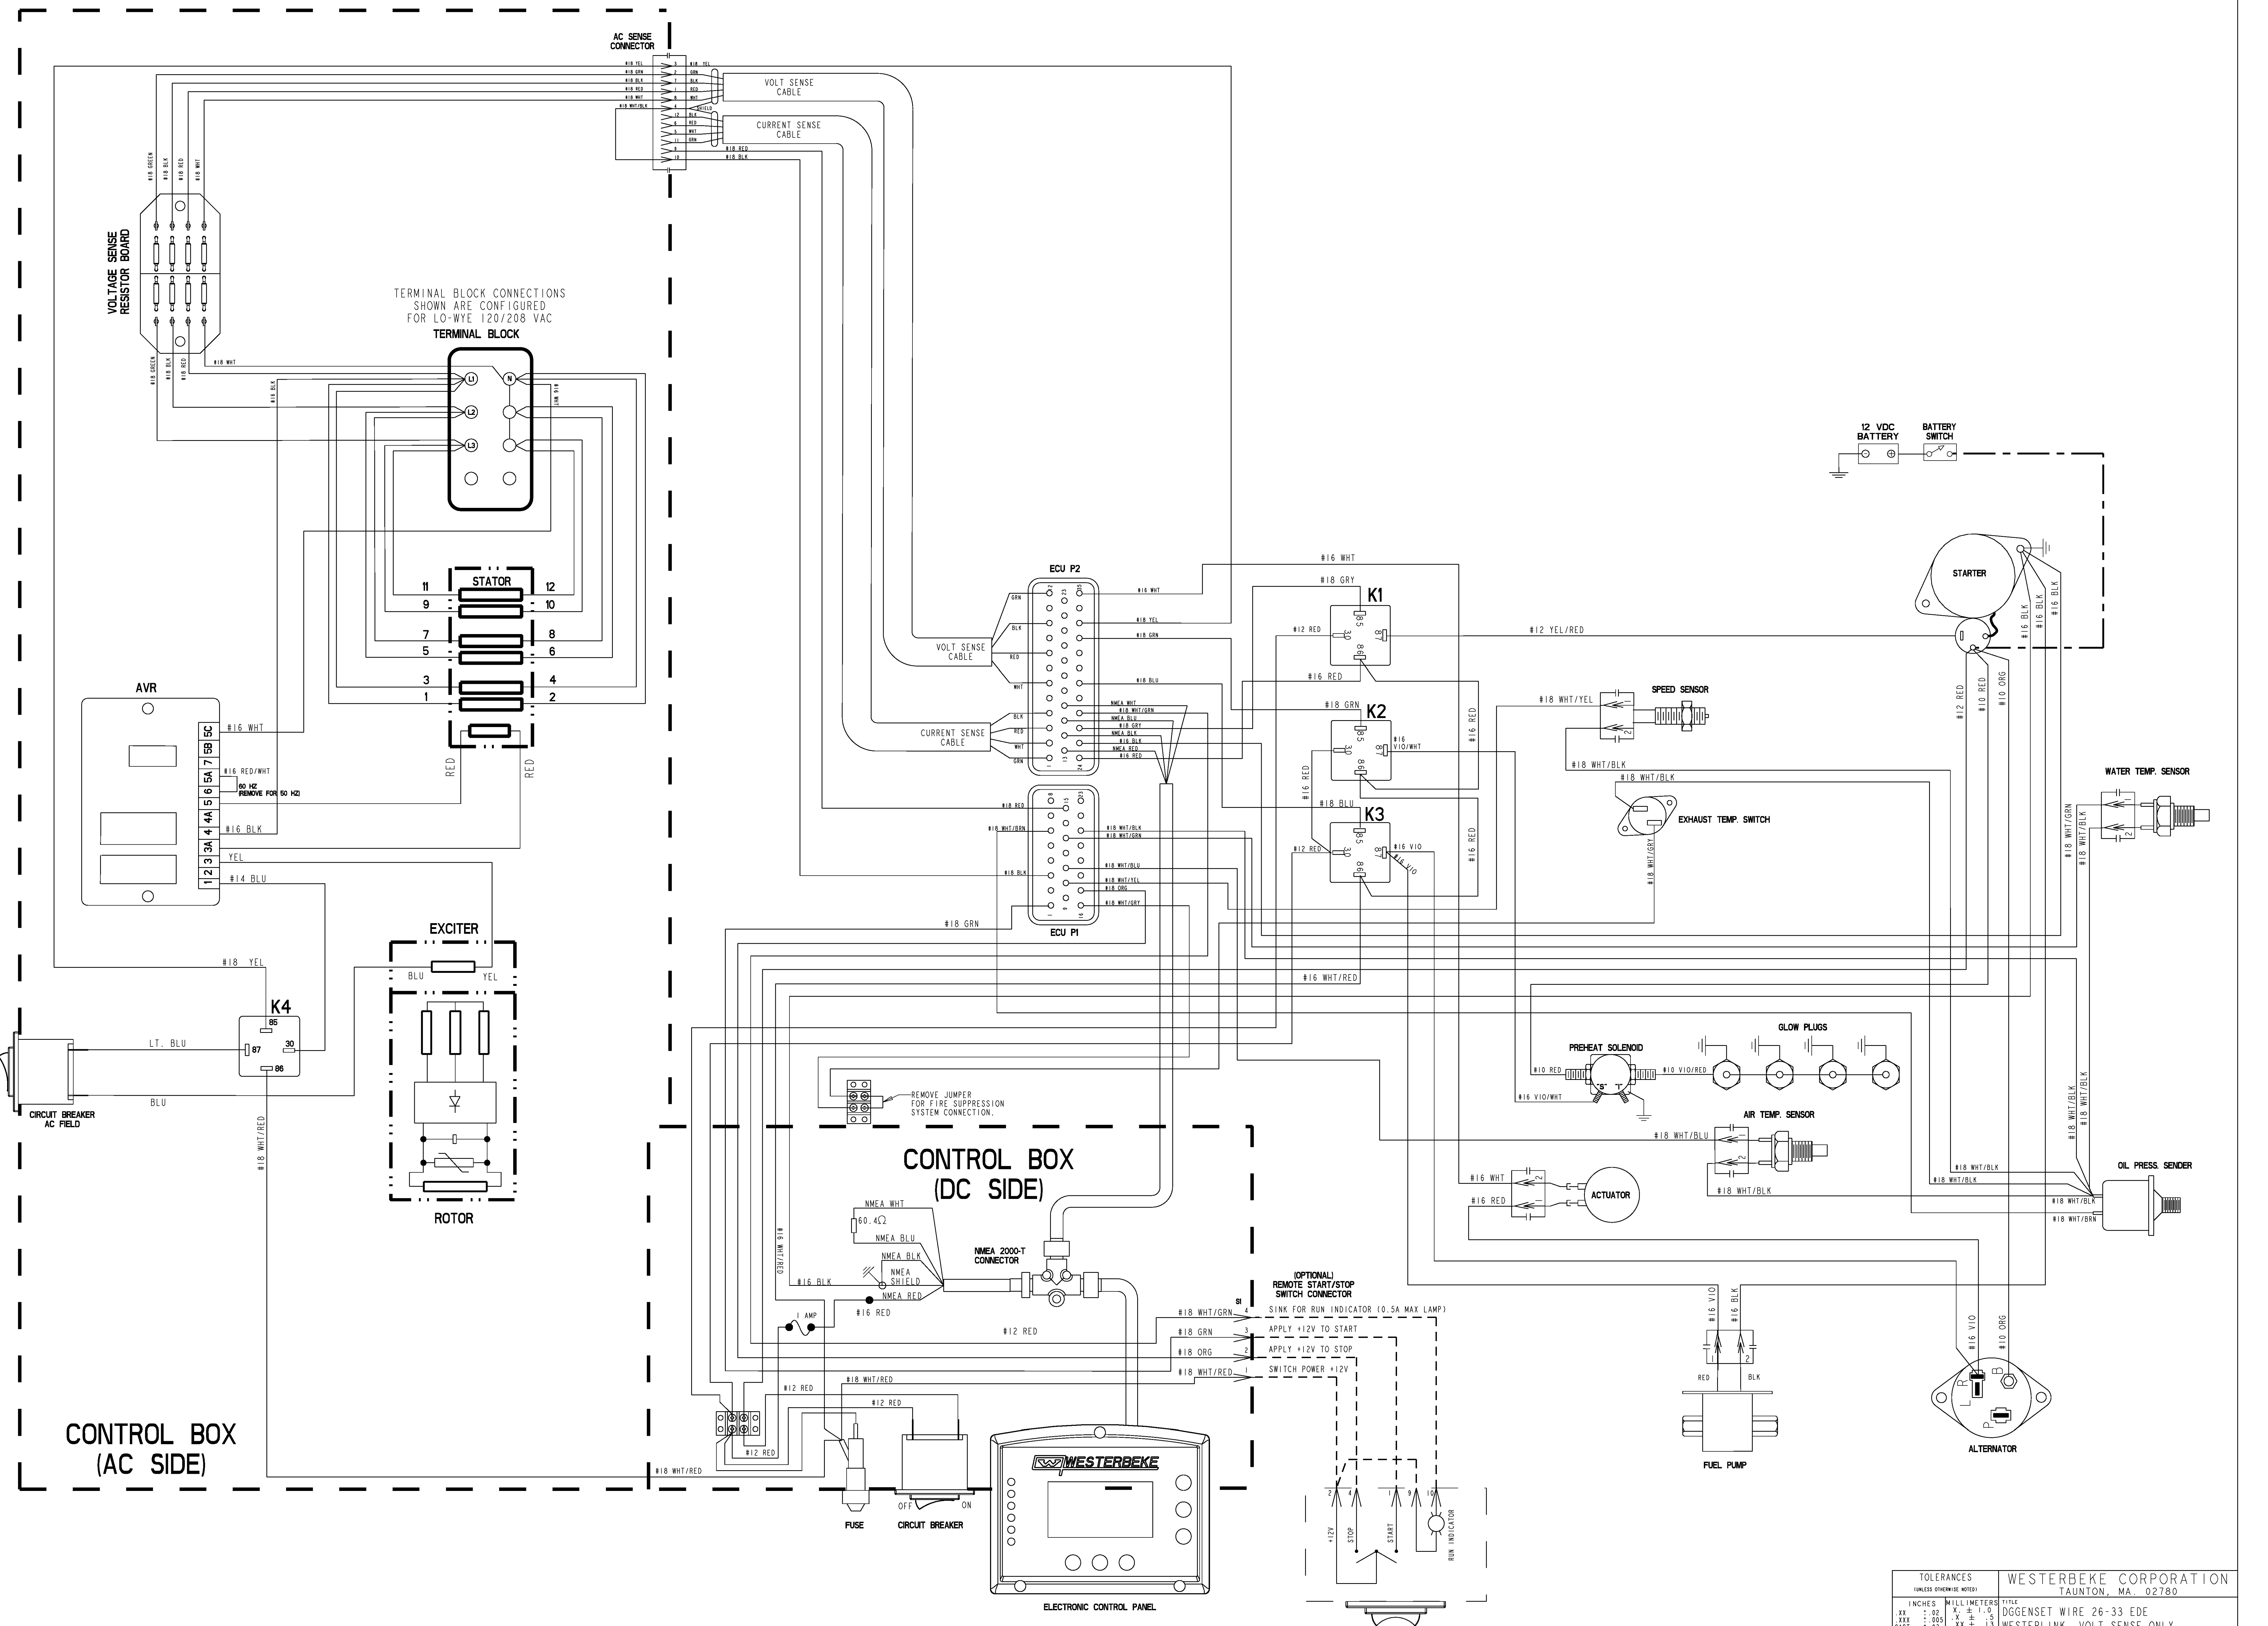

TERMINAL BLOCK CONNECTIONS SHOWN ARE CONFIGURED FOR LO-WYE 120/208 VAC

CONTROL BOX (DC SIDE)

CONTROL BOX (AC SIDE)

TOLERANCES (UNLESS OTHERWISE NOTED)		WESTERBEKE CORPORATION TAUNTON, MA. 02780	
INCHES	MILLIMETERS	TITLE	DWGSET WIRE 26-33 EDE
XX : .005	XX : .125		WESTERLINK, VOLT SENSE ONLY
XXX : .005	XXX : .125	DATE	8/26/06
ANGLES	ANGLES	APPROVED BY	GA
FINISH	FINISH	DATE	8/26/06
DIMENSIONS	DIMENSIONS	SCALE	4.000
INCHES	MILLIMETERS	SIZE	DRAWING NUMBER
(WHEN APPLICABLE)	(WHEN APPLICABLE)	SHT.	1 OF 1
			E
			52951
			B